



NOTES:  
 1. PULLING EYES ON THE WALL AT THE VAULT BOTTOM SHALL BE PLACED FLUSH WITH THE VAULT FLOOR.  
 2. PULLING EYES IN POCKET RECESS IN WALLS.  
 3. CONDUIT TERMINATORS FOR 6" PVC CONDUIT.

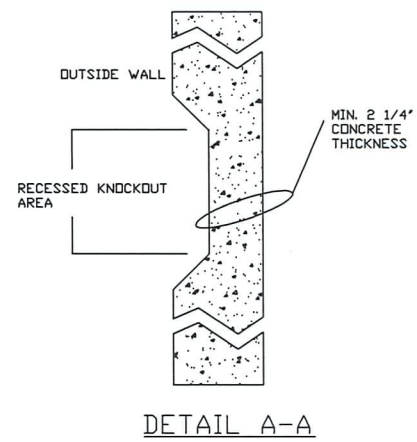

6' X 8' X 7' H.T.  
 PRECAST CONCRETE MANHOLE BASE

 <b>WEST VIRGINIA UNIVERSITY</b>	
<b>STANDARD PRECAST MANHOLE DETAIL</b>	
Drawing #: <b>ELEC-D03</b>	
DRAWN <u>ERIC ROSIE</u>	DATE <u>12/11/03</u>
REVISIONS :	